

Indian Institute of Technology Palakkad
भारतीय प्रौद्योगिकी संस्थान पालक्काड
Under Ministry of Education, Govt. of India
शिक्षा मंत्रालय के अधीन, भारत सरकार



CORRIGENDUM - 018/01


21-08-2024

Sub :NAME OF WORK: DIVERTING ELECTRICAL LOADS OF MAIN CAMPUS FROM NILA CAMPUS, PROVIDING ELECTRICAL SUPPLY TO NEWLY PROPOSED DATA CENTRE OF SAMGATHA BLOCK AND PROVIDING ADDITIONAL STANDBY FACILITY FOR ELECTRICAL LOADS OF AGORA, SAMGATHA AND NEW DATA CENTRE TO SYNCHRONISING PANEL OF 500 KVA AND 250 KVA DG SET AT IIT PALAKKAD


Ref: 17/IITPKD/EWD/ELE/2024-25/018, dated 14.08.2024

SI No	Existing Entry	To be read as
1.0	Attached Single Line Diagram - bus bar is copper. In schedule of work item no. 01, 02 and 03 bus bars are aluminium.	Aluminium bus bar as per schedule of work.
2	Make of MCCB in List of preferred make sl.no. 02 - Legrand -DX3 / Schneider -NSX / Siemens 3VL	Make of MCCB - Legrand -DX3 / Schneider -NSX / Siemens 3VL / L&T d-sine


Other terms and conditions of the tender document are unaltered


CHAIRMAN, EWD
21/8

SLD OF THE PROPOSED WORK

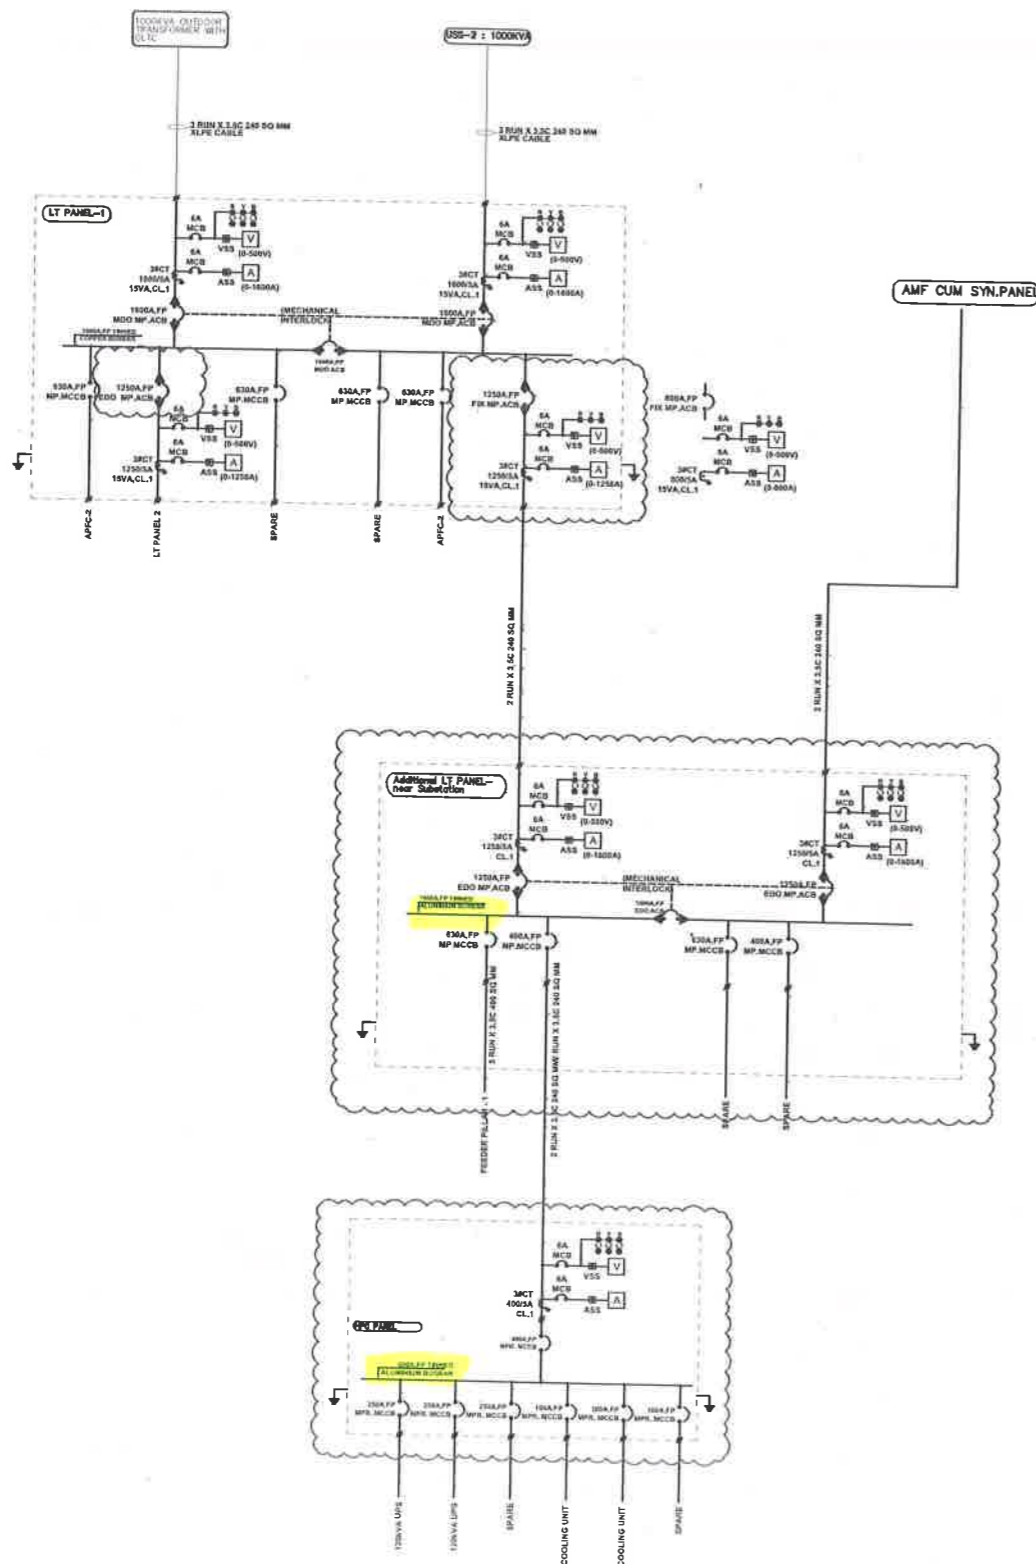

AT NILA CAMPUS DULY MARKING THE NEW ITEMS

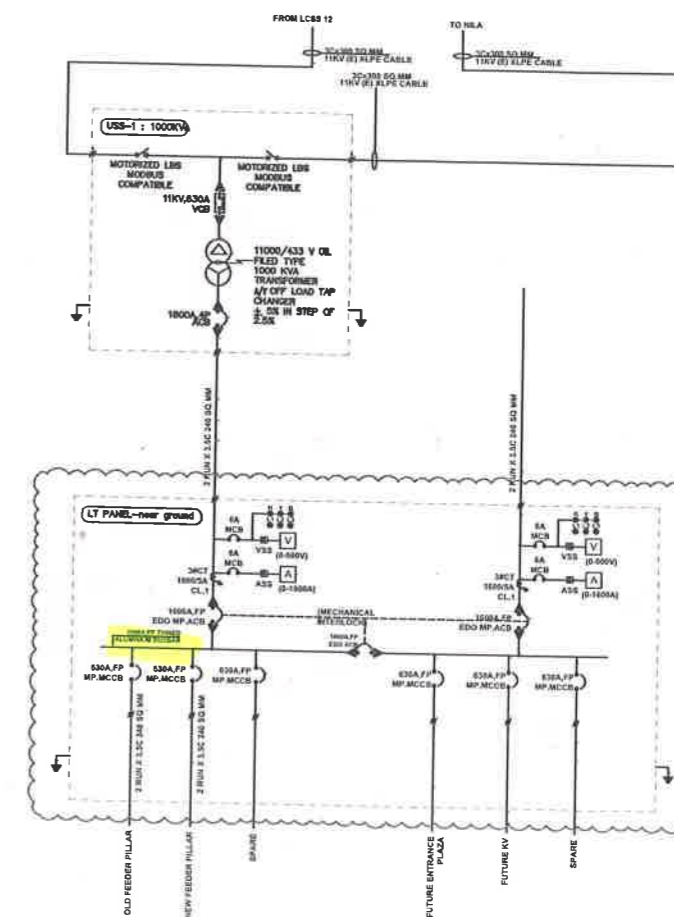

NEAR GROUND SAHYADRI CAMPUS DULY MARKING THE NEW ITEMS